


空調機器騒音周波数分析表

記号		名称	〇〇病院改修工事				
室名	A	騒音値(NC)	運転中①	55.0	運転中②	停止中	35.0

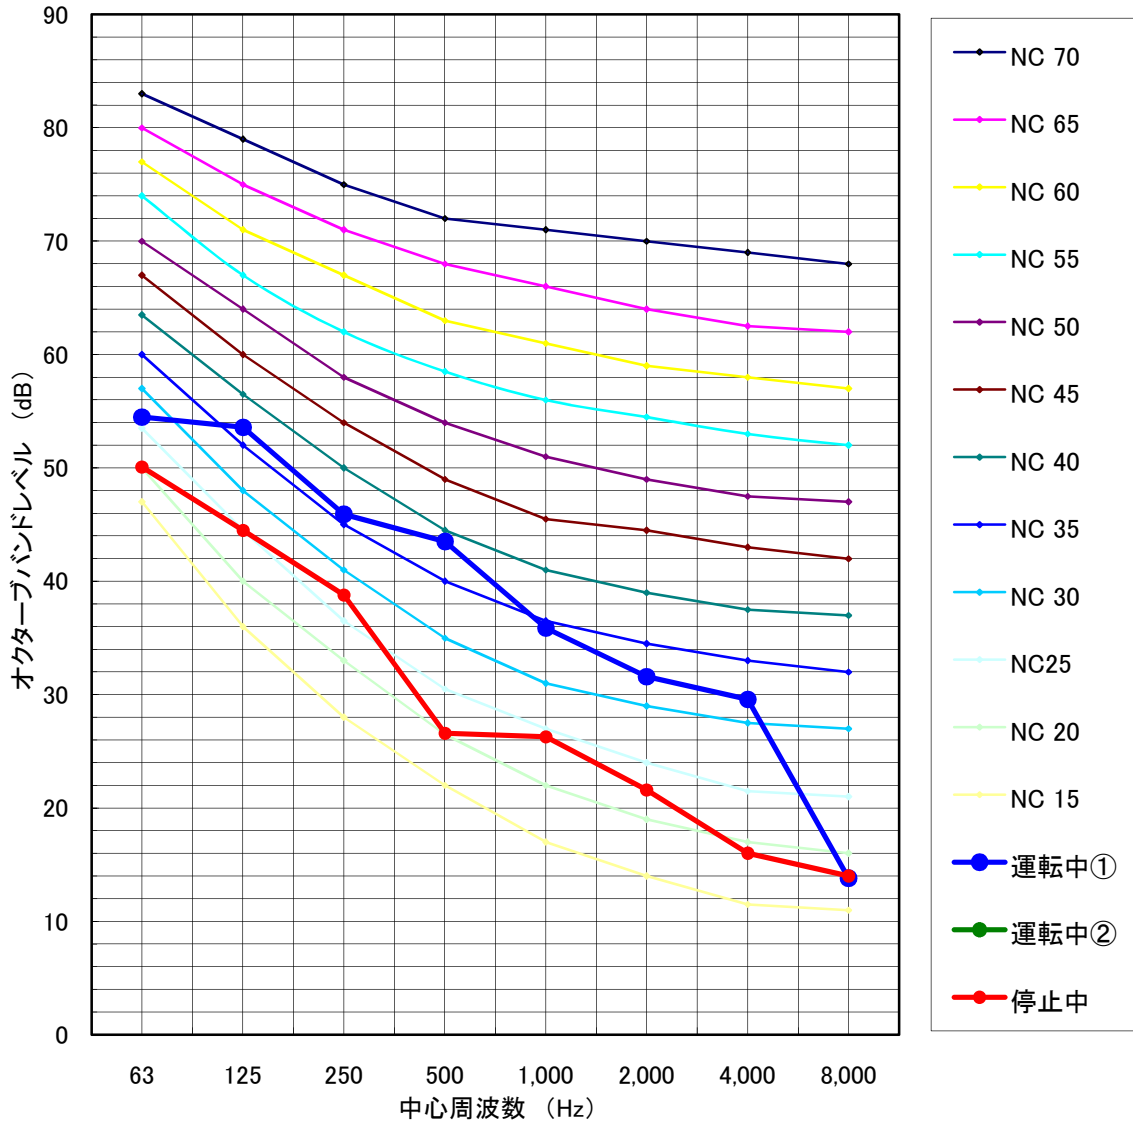

	NC 70	NC 65	NC 60	NC 55	NC 50	NC 45	NC 40	NC 35	NC 30	NC 25	NC 20	NC 15	測定値		
													運転中①	運転中②	停止中
63	83	80	77	74	70	67	63.5	60	57	53.5	50	47	54.5		50.1
125	79	75	71	67	64	60	56.5	52	48	44.5	40	36	53.6		44.5
250	75	71	67	62	58	54	50	45	41	36.5	33	28	45.9		38.8
500	72	68	63	58.5	54	49	44.5	40	35	30.5	26.5	22	43.5		26.6
1,000	71	66	61	56	51	45.5	41	36.5	31	27	22	17	35.9		26.3
2,000	70	64	59	54.5	49	44.5	39	34.5	29	24	19	14	31.6		21.6
4,000	69	62.5	58	53	47.5	43	37.5	33	27.5	21.5	17	11.5	29.6		16
8,000	68	62	57	52	47	42	37	32	27	21	16	11	13.8		14